# TOWN OF FRONT ROYAL
# TEMPORARY SERVICE POLE
# SPECIFICATIONS

NOTES:

1. ALL DIMENSIONS SHOWN ARE MINIMUM.
2. ADDITIONAL HEIGHT MAY BE NECESSARY TO PROVIDE PROPER SERVICE DROP NESC CLEARANCE.
3. ONE BRACE TO BE IN DIRECTION OF SERVICE. AT LEAST ONE ADDITIONAL BRACE TO BE LOCATED AT 90° TO DIRECTION OF SERVICE
4. SOIL TO BE FIRMLY TAMPED AROUND POLE AND STAKES DRIVEN INTO FIRM EARTH.
5. CUSTOMER FURNISHES ALL ITEMS EXCEPT METER. THE METER BASE, WIRING, SERVICE EQUIPMENT, AND GROUND ON THE POLE ARE TO BE INSTALLED BY THE CUSTOMER'S ELECTRICIAN IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE AND LOCAL ORDINANCES.
6. SOLID, ONE PIECE, 4" X 4" WOOD POST MAY BE SUBSTITUTED WITH ENERGY SERVICE'S APPROVAL.
7. CUSTOMER MUST CONSULT WITH COMPANY FOR LOCATION OF TEMPORARY SERVICE POLE OR SUPPORT. ALSO, CUSTOMER MUST PAY APPLICABLE CHARGES.
8. ALL CUSTOMER WORK MUST BE COMPLETED AND REQUIRED INSPECTIONS BE OBTAINED BEFORE TOWN OF FRONT ROYAL WILL PROVIDE SERVICE.

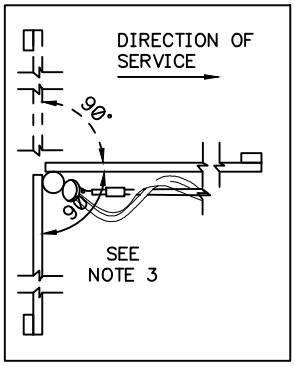


PLAN VIEW

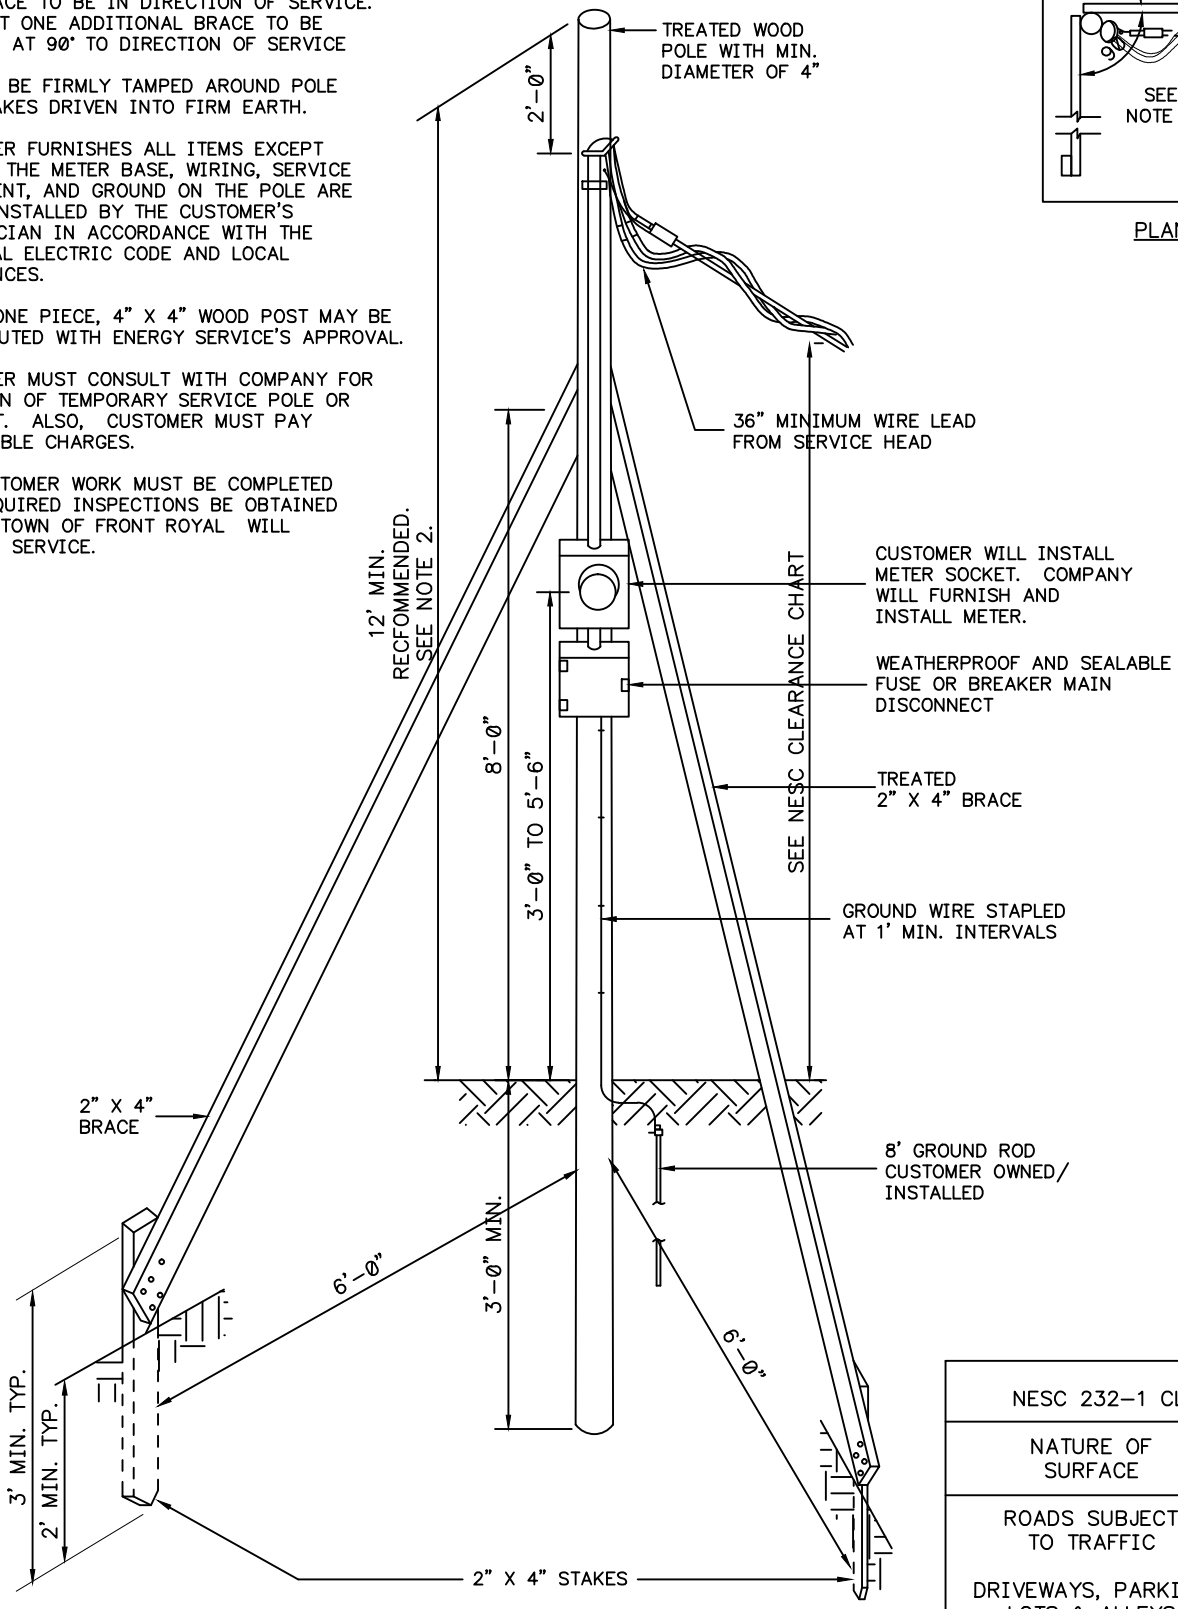


| NESC 232-1 CLEARANCES | |
|---|---|
| NATURE OF SURFACE | MIN. TO GRADE |
| ROADS SUBJECT TO TRAFFIC | 16 FT. |
| DRIVEWAYS, PARKING LOTS & ALLEYS | 16 FT. |
| SUBJECT TO PEDESTRIAN TRAFFIC ONLY | 12 FT. |